


- NOTES**
1. GRADE SEWER EVENLY BETWEEN MH/MS TO LEVELS SHOWN IN DESIGN DRAWINGS.
 2. LAY PIPES AND FITTINGS WITH SOCKETS UPSTREAM WHEREVER PRACTICABLE.
 3. WATER SEALS TYPICALLY NOT REQUIRED.

PROPERTIES THIS SIDE SERVICED FROM EASEMENT OR LOWER ROAD
TYPICAL RETICULATION SEWER

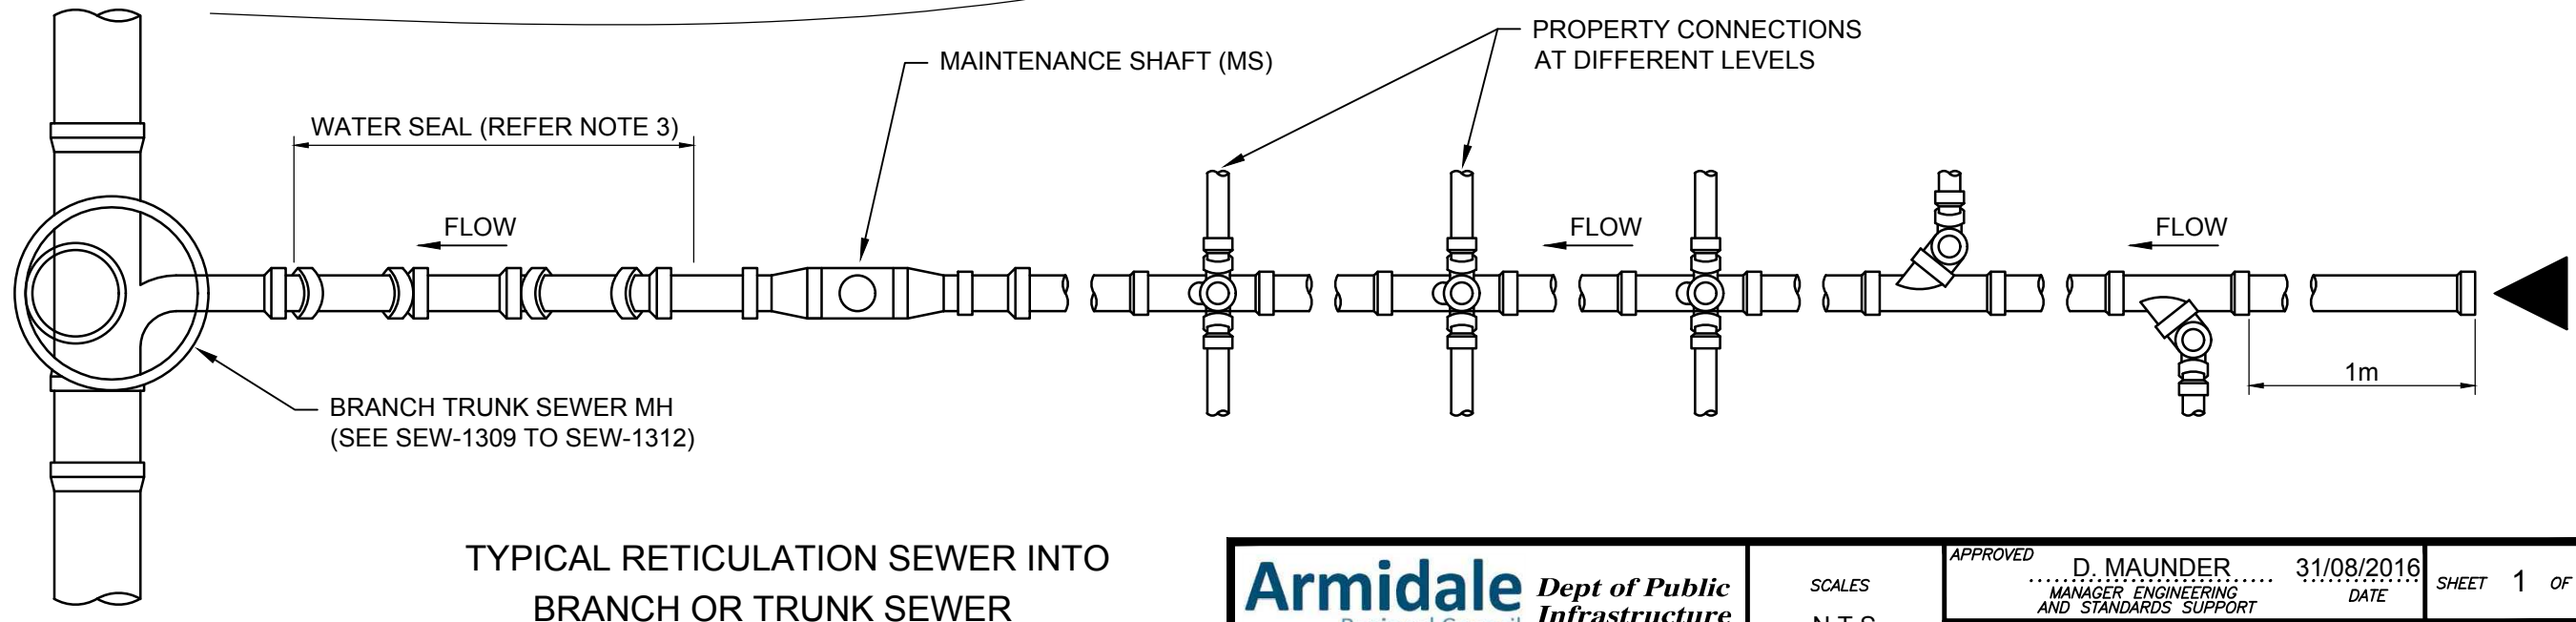

TYPICAL RETICULATION SEWER INTO BRANCH OR TRUNK SEWER

Armidale <small>Regional Council</small> Dept of Public Infrastructure	SCALES N.T.S	APPROVED D. MAUNDER MANAGER ENGINEERING AND STANDARDS SUPPORT 31/08/2016 DATE	SHEET 1 OF 1
	TYPICAL PIPE LAYING ARRANGEMENT	SURV	AS SHEET SIZE A3
		DRWN JB	DRAWING No 010-024
		DES	AMDT No
CHKD MW	CADFILE 010-024.dwg	DATE 31/08/2016	